


TOP VIEW OF SLAB

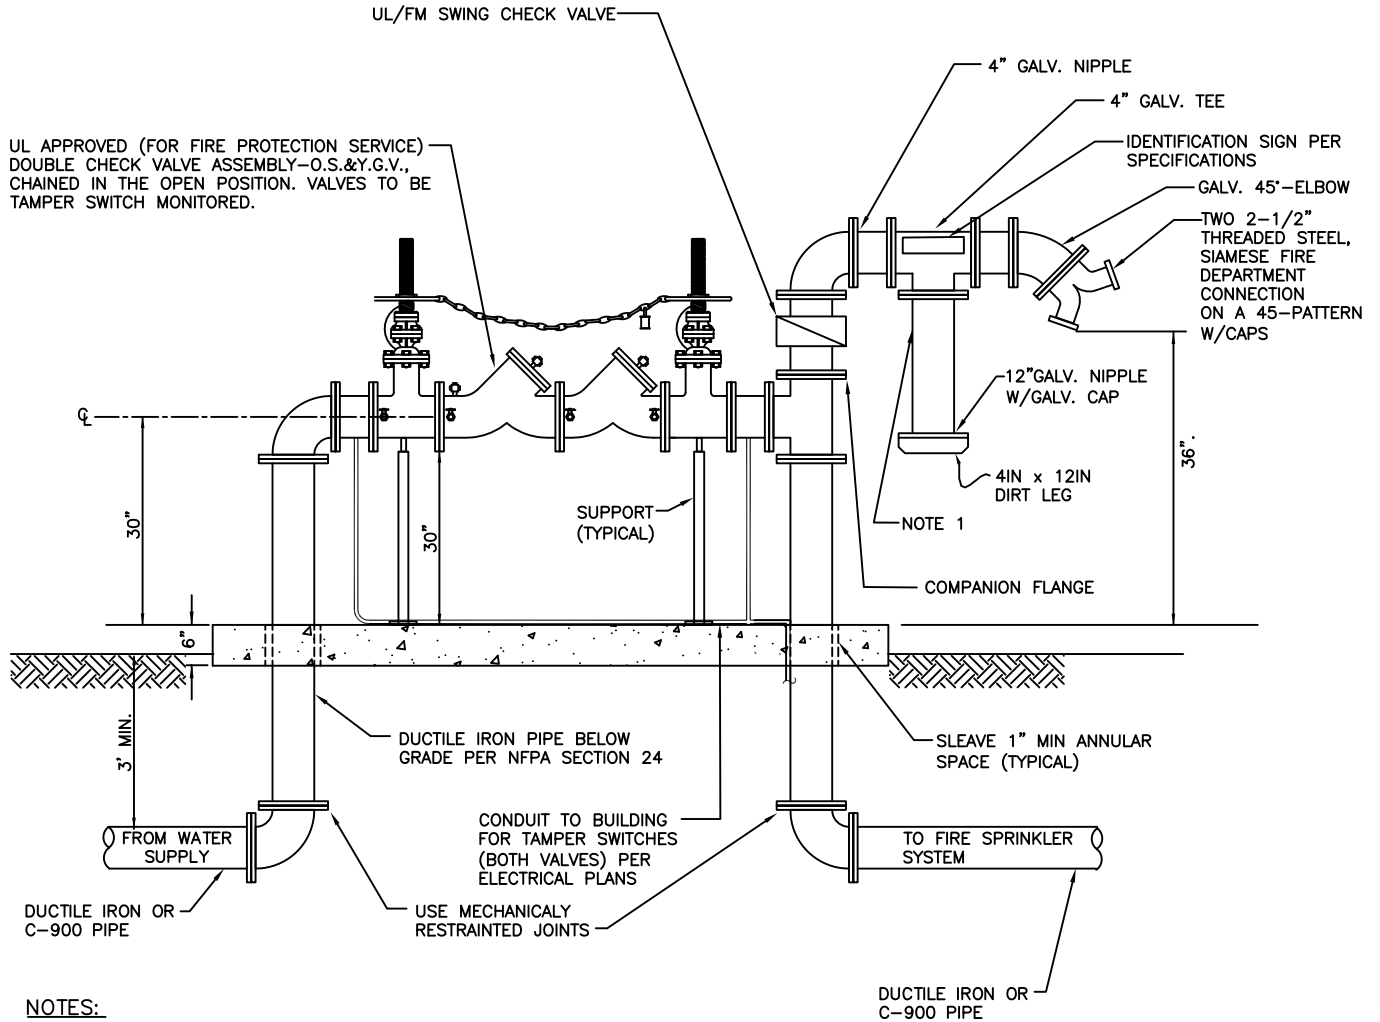

NOTES:

1. SIGNAGE PER CAMPUS STANDARD IDENTIFY BUILDING BY NAME OR PICTOGRAM AS REQUIRED BY FIRE DEPARTMENT.
2. ALL STEEL PIPE SHALL BE AS PER AWWA C-200 WITH $\frac{1}{8}$ " WALL AND COATED AND LINED BY FUSION BONDED EPOXY AS PER AWWA C-213, 20 MILS MIN.
3. ALL STEEL FLANGES SHALL BE CLASS D AS PER AWWA C-207.
4. ALL DUCTILE IRON FITTINGS SHALL MEET AWWA C-110 & C-153, CLASS 150. THE INTERIOR SHALL BE MORTAR LINED AS PER AWWA C-104 AND BELOW GROUND EXTERIOR SHALL HAVE A COAL TAR COATING AS PER AWWA C-203.
5. ALL NUTS AND BOLTS BELOW GROUND SHALL BE POLYETHYLENE ENCASED AS PER AWWA C-105 OR TAPE WRAPPED AS PER AWWA C-209, 20 MILS MIN. IN BOTH CASES.
6. BOTH GATE VALVES SHALL BE SUPERVISED BY THE FIRE ALARM SYSTEM.
7. CONTRACTOR SHALL PROVIDE CHAIN FOR LOCKING WHEELS TOGETHER (UNIVERSITY TO PROVIDE LOCK).
8. CONTRACTOR SHALL PROVIDE REMOVABLE INSULATION BLANKET.

UNIVERSITY OF CALIFORNIA, DAVIS		
DOUBLE CHECK VALVE ASSEMBLY - FW SERVICE		
REVISION: 2		
SCALE: NONE	DATE: JULY 2011	
DWN: KH CHK: VG	APPROVED	FILE NO. DW-01