


TOP VIEW OF SLAB

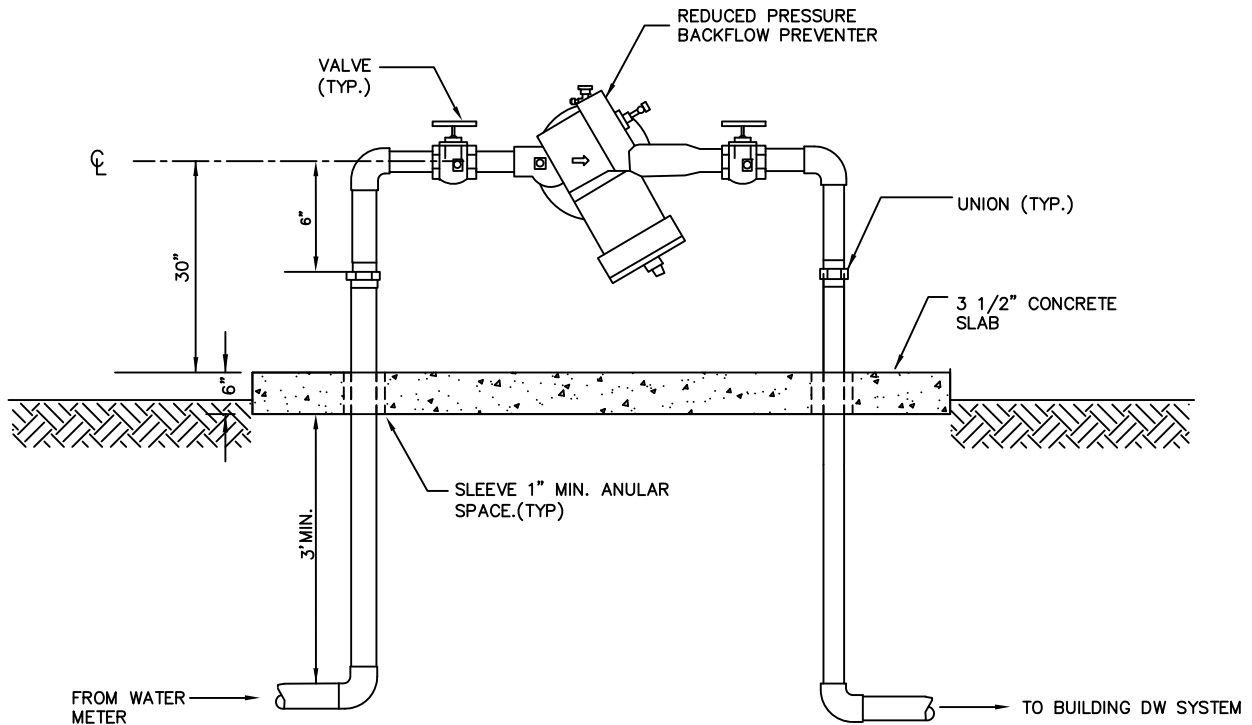

NOTES:

1. ALL PIPE AND FITTINGS SHALL BE COPPER TYPE OR BRASS.
2. PROVIDE REMOVEABLE INSULATED BLANKET FROSTGUARD FG-1 OR EQUAL.

UNIVERSITY OF CALIFORNIA, DAVIS		
REDUCED PRESSURE BACKFLOW PREVENTER 2" AND SMALLER DW SERVICE		
REVISION: 2		
SCALE: NONE	DATE: JULY 2011	
DWN: KH CHK: VG	APPROVED	FILE NO. DW-03