



VALVE BOX & RISER. REFER TO DETAIL [OMNI C2 METER 3", 4", 6"]

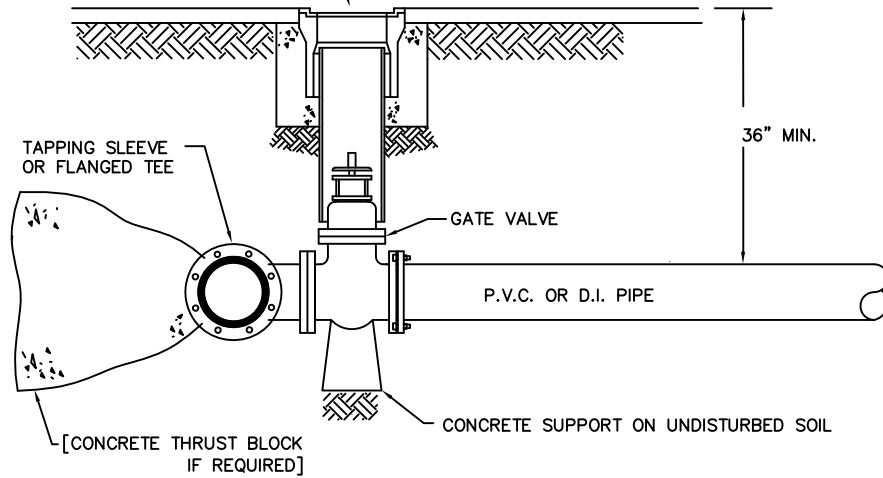

SECTION

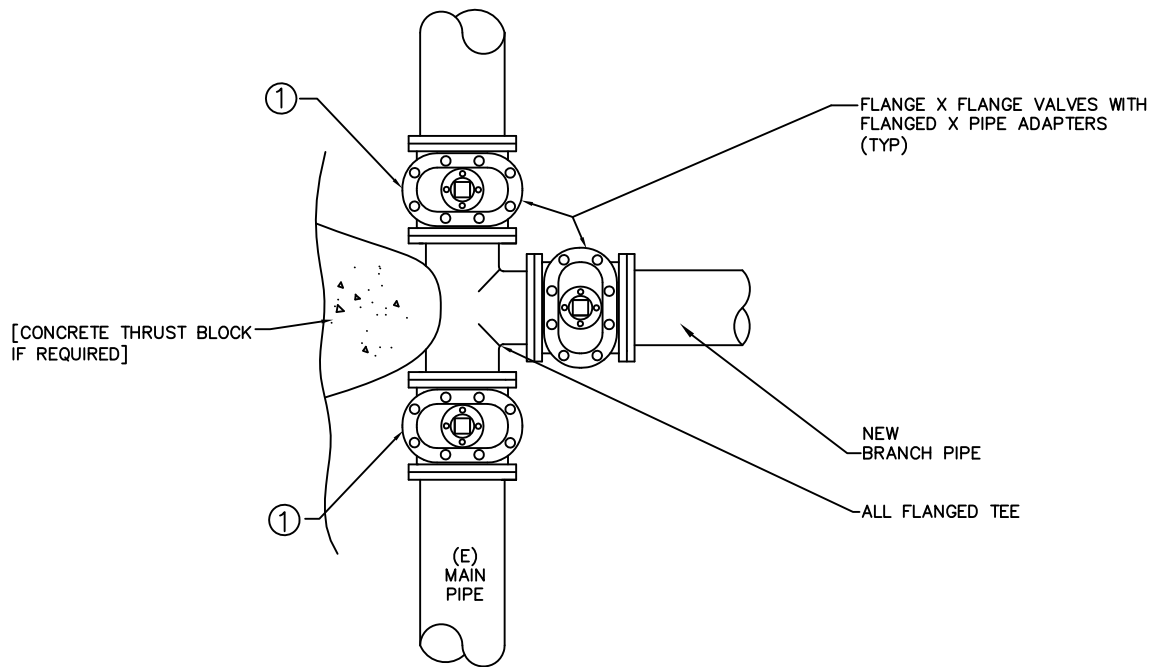

PLAN

NOTES:

1. VALVES ON MAIN PIPE ARE NOT REQUIRED AT FIRE HYDRANT

NOTES TO DESIGN PROFESSIONAL:

1. VERIFY AND EDIT TEXT IN BRACKETS [].

UNIVERSITY OF CALIFORNIA, DAVIS

TEE CONNECTION @ MAIN

REVISION: 2

SCALE: NONE

DATE: JULY 2011

DWN: KH
CHK: VG

APPROVED

FILE NO.
DW-07