


1-SACK CONCRETE SLURRY FROM UNDISURBED EARTH TO CENTERLINE OF PIPE. SLURRY TO SUPPORT AC PIPE AND COUPLING. INSTALL ON BOTH SIDES FOR PIPE REPLACEMENT

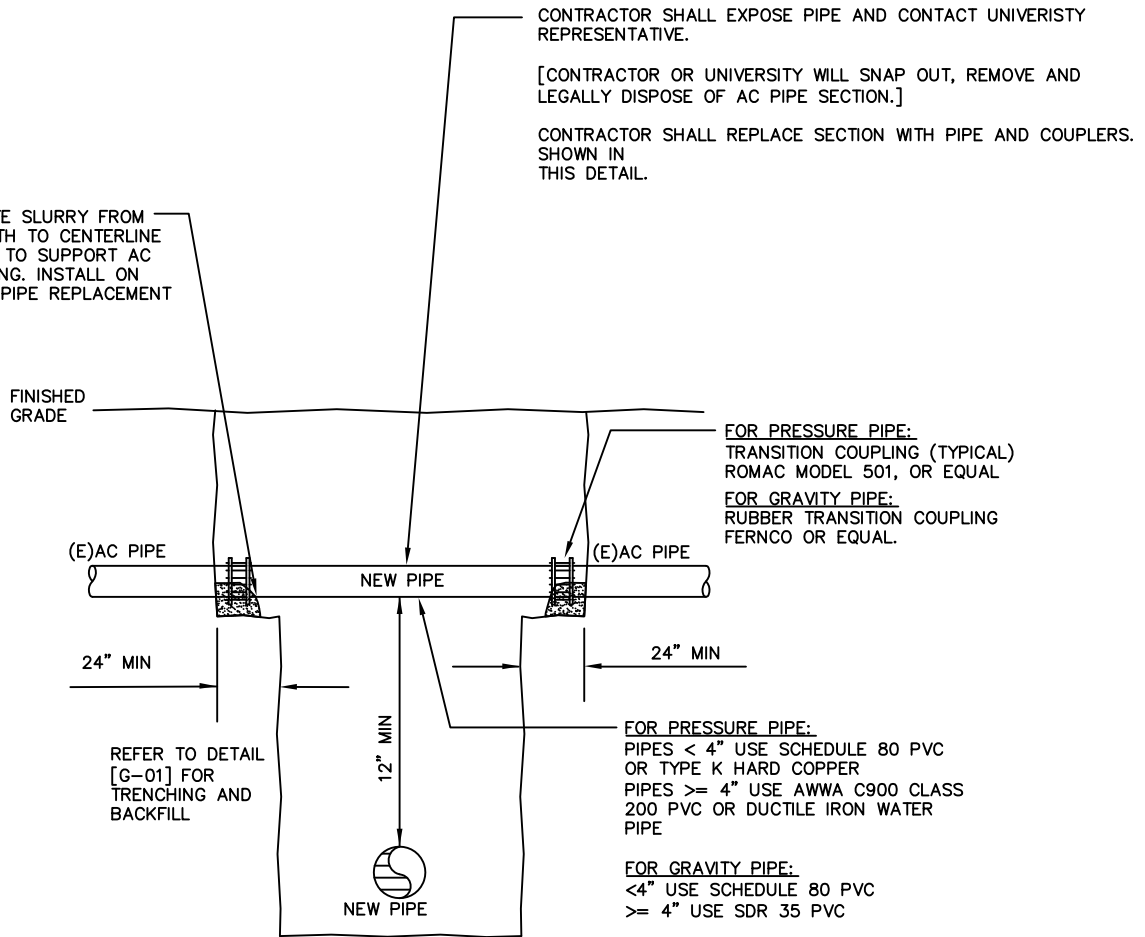

**NOTES:**

1. IF EITHER PIPE IS DOMESTIC WATER REFER TO THE MOST RECENT VERSION OF THE STATE OF CALIFORNIA DEPARTMENT OF HEALTH SERVICES "GUIDANCE CRITERIA FOR THE SEPARATION OF WATER MAINS AND NON-POTABLE PIPELINES."

**NOTES TO DESIGN PROFESSIONAL:**

1. VERIFY AND EDIT TEXT IN BRACKETS [ ].

**UNIVERSITY OF CALIFORNIA, DAVIS**

**ASBESTOS CEMENT PIPE UNDER CROSSING**

REVISION: 0

SCALE: NONE      DATE: JULY 07

DWN: KH	APPROVED	FILE NO.
CHK: VG		G-06