


NOTES:

1. USE MECHANICAL JOINT OR FLANGED FITTINGS WITH RESTRAINED JOINTS.
2. ALL BENDS SHALL BE 45° OR 22-1/2° FITTINGS. NO 90° BENDS ALLOWED.
3. REFERENCE TRENCH DETAILS. [SEE G-01 AND G-02]
4. IF EITHER PIPE IS DOMESTIC WATER REFER TO THE MOST RECENT VERSION OF THE STATE OF CALIFORNIA DEPARTMENT OF HEALTH SERVICES DIVISION "CRITERIA FOR THE SEPARATION OF WATER MAINS AND NON-POTABLE PIPELINES".

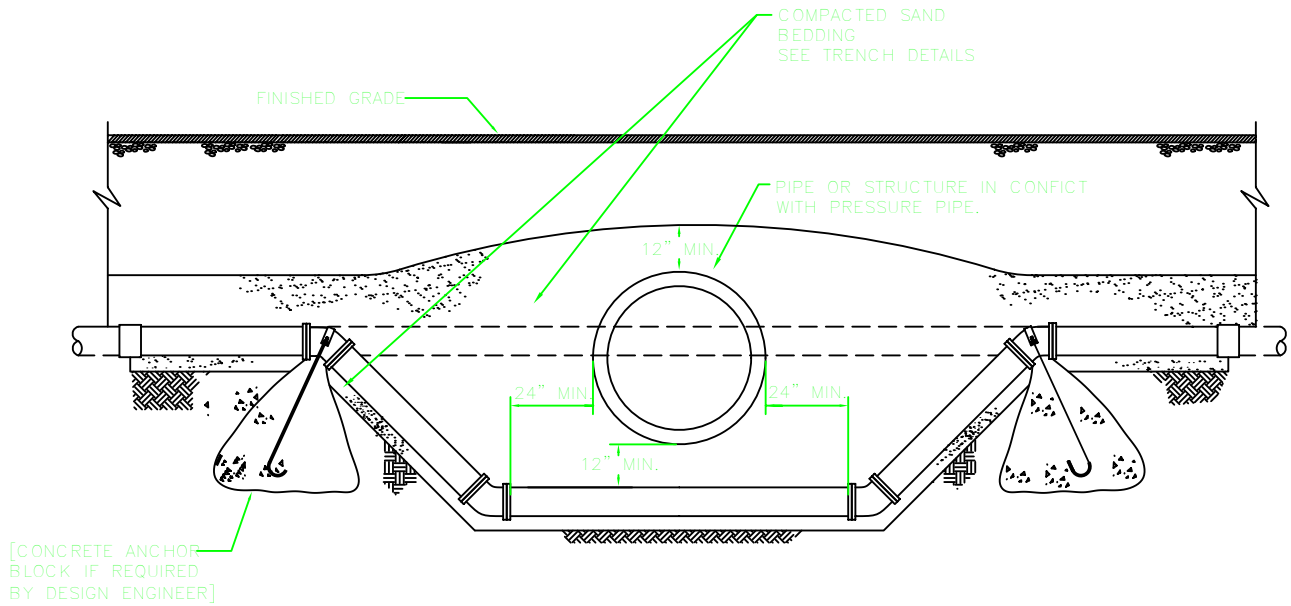

NOTES:

1. USE MECHANICAL JOINT OR FLANGED FITTINGS WITH RESTRAINED JOINTS.
2. ALL BENDS SHALL BE 45° OR 22-1/2° FITTINGS. NO 90° BENDS ALLOWED.
3. REFERENCE TRENCH DETAILS. [SEE G-01 AND G-02]
4. IF EITHER PIPE IS DOMESTIC WATER REFER TO THE MOST RECENT VERSION OF THE STATE OF CALIFORNIA DEPARTMENT OF HEALTH SERVICES GUIDANCE "CRITERIA FOR THE SEPARATION OF WATER MAINS AND NON-POTABLE PIPELINES".

NOTES TO DESIGN PROFESSIONAL:

1. VERIFY AND EDIT TEXT IN BRACKETS [].